



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Overhead Door Corporation
2501 South State Hwy 121, Suite 200
Lewisville, TX 75067

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 625/626 Steel Rolling Door up to 22'-0" Wide

APPROVAL DOCUMENT: Drawing No. **308134**, titled "Series 625 Rolling Service Door 22' Dade County", sheets 1 and 2 of 2, dated 09/05/2003 and 10/10/2003, with revision H dated 05/03/2013, prepared by Overhead Door Corporation, signed and sealed by Mark A. Sawicki, P.E. on 12/17/2015, bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, Lewistown, PA, model/series number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **13-1121.05** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**

MIAMI-DADE COUNTY
APPROVED

[Signature]
04/14/2016

NOA No. 15-1228.04
Expiration Date: October 14, 2019
Approval Date: April 21, 2016
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **308134**, titled "Series 625 Rolling Service Door 22' Dade County", sheets 1 and 2 of 2, dated 09/05/2003 and 10/10/2003, with revision H dated 05/03/2013, prepared by Overhead Door Corporation, signed and sealed by Mark A. Sawicki, P.E. on 12/17/2015.

B. TESTS "*Submitted under NOA # 13-1121.05*"

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Resistance Test per FBC, TAS 202-94
5) Tensile Test per ASTM E 8,
along with marked-up drawings and installation diagram of a Series 625 Series rolling garage door, prepared by Architectural Testing, Inc, Test Report No. **C8191.01-109-18**, dated 08/30/2013, signed and sealed by Michael D. Stremmel, P.E.
2. Test report on Salt Fog Spray Test per ASTM B-117 of G90 and G40 galvanized steel with prime coat samples, prepared by Environmental Testing Laboratory, Inc, Test Report No. **12732**, dated 06/22/2013 and signed by Brady Richard.
3. Test report on Surface Burning Characteristics per ASTM E84 of 625 Series open-faced FIP slats, prepared by Intertek, Test report No. **101187309SAT-001A**, dated 06/14/2013 and signed by Servando Romo.
4. Test report on Ignition Properties per ASTM D1929 of thermacore polyurethane, prepared by Intertek, Test Report No. **101187309MID-002**, dated 05/28/2013, signed and sealed by Mark Crawford.

"Submitted under NOA # 05-1003.24"

5. Test report on Surface Burning characteristics per ASTM E84 of slats insulated with 2lb polyurethane foam, prepared by Intertek, Test report No. **3061869-001r1**, dated 07/13/2004 and signed by J. Tanner.
6. Test report on Ignition Properties per ASTM D1929 of Polyurethane Foam insulation, prepared by Omega Point Laboratories, Test Report No. **17042-120730**, dated 09/12/2004, signed and sealed by W. E. Fith, P.E.
7. Test report on Salt Spray Fog Test per ASTM B-117 of G30, G40 & G90 samples, prepared by Environmental Testing Laboratory, Test Report No. **ETL-9100550287**, dated 03/13/2006 and signed by B. Richard.



04/14/2016

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 15-1228.04
Expiration Date: October 14, 2019
Approval Date: April 21, 2016

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (Continued)

"Submitted under NOA # 03-1015.04"

8. Test report on Uniform Static Air Pressure Test per FBC, TAS 202, Large Missile Impact Test per FBC, TAS 201, Cyclic Wind Pressure Test per FBC, TAS 203 and Tensile Test per ASTM E8 of a 22' x 10' steel roll-up service door, prepared by Architectural Testing, Inc., Test Report No. **ATI 01-43464.01**, dated 09/10/2003 signed and sealed by L. G. Krupke, P.E.

C. CALCULATIONS *"Submitted under NOA # 13-1121.05"*

1. Wall fastener calculations prepared by Overhead Door Corporation, dated 10/31/2013, signed and sealed by Mark A. Sawicki, P.E.

"Submitted under NOA # 05-1003.24"

2. Calculations for Dade County Product Approval of 22, 20 & 18 Gauge Rolling Garage Door, prepared by Overhead Door Corporation on sheet 2 of 3, signed and sealed by LeRoy G. Krupke, P.E. on 09/16/2005.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 5th edition (2014) FBC issued by Overhead Door Corporation, dated 12/15/2015, signed and sealed by Mark A. Sawicki, P.E.

"Submitted under NOA # 13-1121.05"

2. Statement letter of code conformance to FBC 2010 and no financial interest prepared by Overhead Door Corporation, dated 10/31/2013, signed and sealed by Mark A. Sawicki, P.E.


04/14/2016


Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 15-1228.04
Expiration Date: October 14, 2019
Approval Date: April 21, 2016

NOTES








1. (-W/L) = NEGATIVE WINDLOAD
(+W/L) = POSITIVE WINDLOAD
2. WALL ANGLES MAY BE WELDED TO STEEL JAMB.
SEE SHEET 2 FOR WELDING DETAILS.
3. RATED DESIGN LOAD ± 65 PSF.
4. CURTAIN MATERIAL: ASTM A-653 CS TYPE B.
GUIDE MATERIAL: ASTM A-36
5. ALTERNATE CURTAIN MATERIAL: AISI-304 SS.
MINIMUM YIELD 40,000 PSI.
6. CURTAIN MATERIAL SHALL BE GALVANIZED ACCORDING
TO ASTM A-525 TO G40 MINIMUM.
7. THE DOOR MUST BE INSTALLED WITH THE TENSION WHEEL
FACING THE INSIDE OF THE BUILDING.
8. PINS MUST BE ENGAGED AND CHAIN MUST BE HOOKED WHEN
HURRICANE WINDS ARE ANNOUNCED.
9. WIND LOCKS ARE REQUIRED ON EACH SLAT
9. WINDLOCK MATERIAL: LOW CARBON CAST STEEL, GRADE 70-46
(485-250) PER ASTM A27. MIN TENSILE 70-KSI MIN YIELD
36-KSI, MIN ELONG 22%
10. WINDLOCKS ATTACHED TO EACH SLAT (CONTINUOUS)
11. RIVET SPECIFICATION:
1/4" DIAMETER RIVET, MINIMUM 1006 LOW-CARBON STEEL.

* LOADS - PER FOOT OF HEIGHT F-265 - DOOR SIZE REF. SUMMARY

LBS/FT DOOR HEIGHT	(E-MOUNT) LOADS *			(Z-MOUNT) LOADS *		
	22 GA **	20 GA	18 GA	22 GA **	20 GA	18 GA
REACTION	8345	8221	8008	2314	2285	2238
NORMAL	715	715	715	715	715	715
PARALLEL	2391	2365	2304	2391	2365	2304

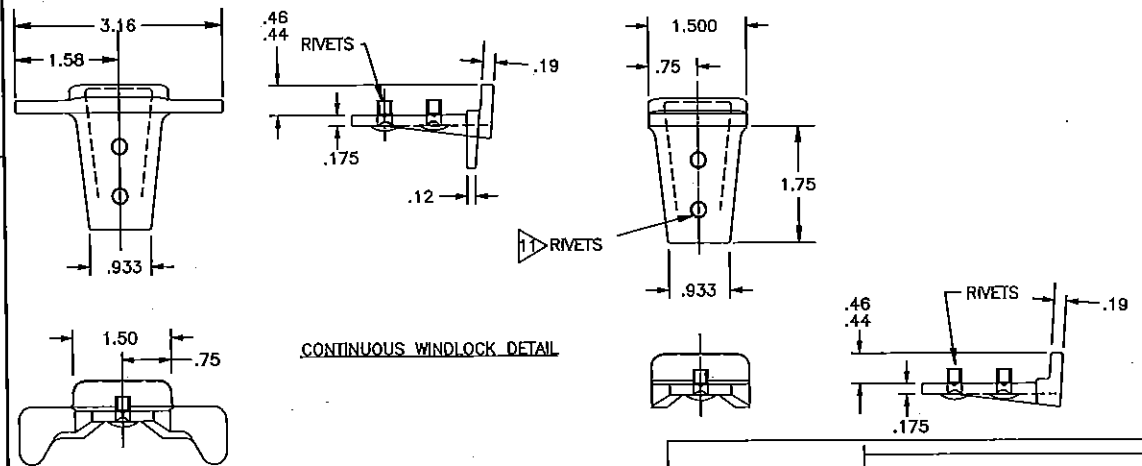


****PIN MUST BE ENGAGED FOR DOOR TO WITHSTAND DESIGN LOADS****

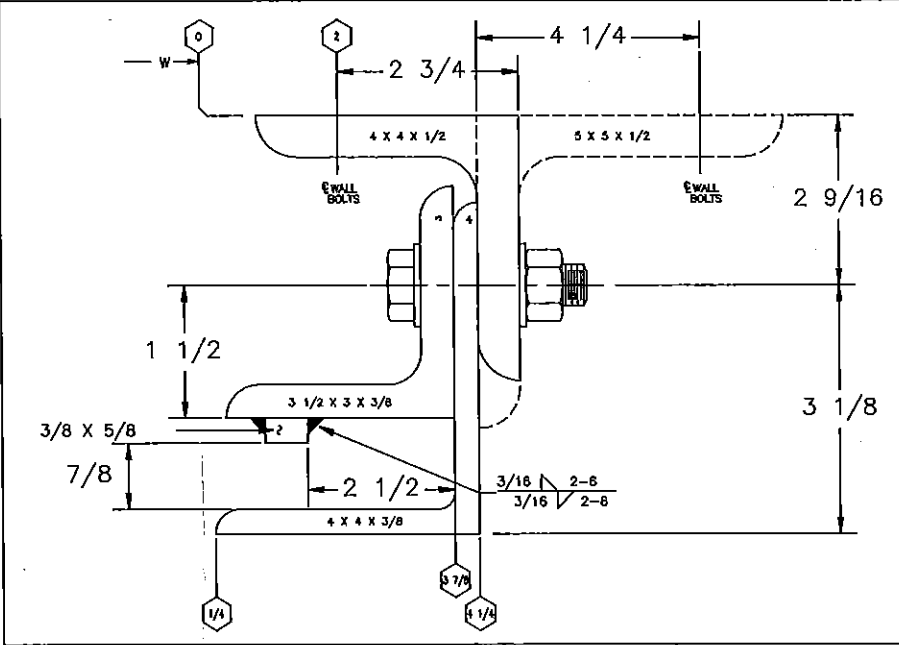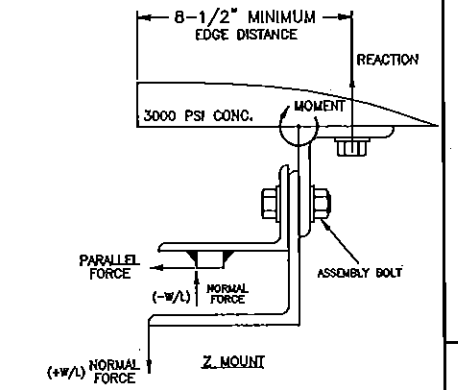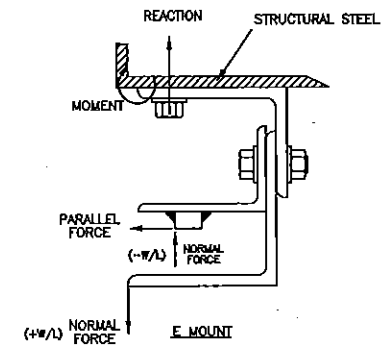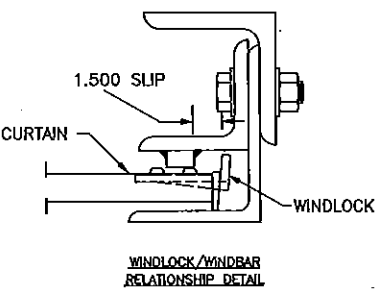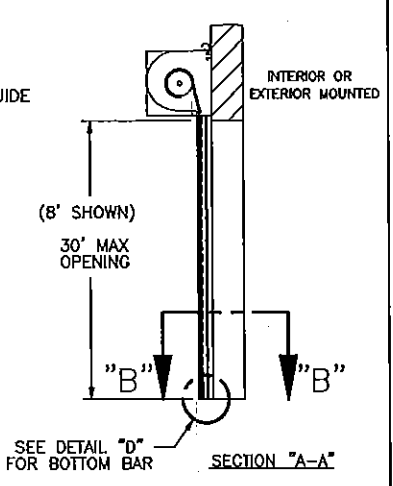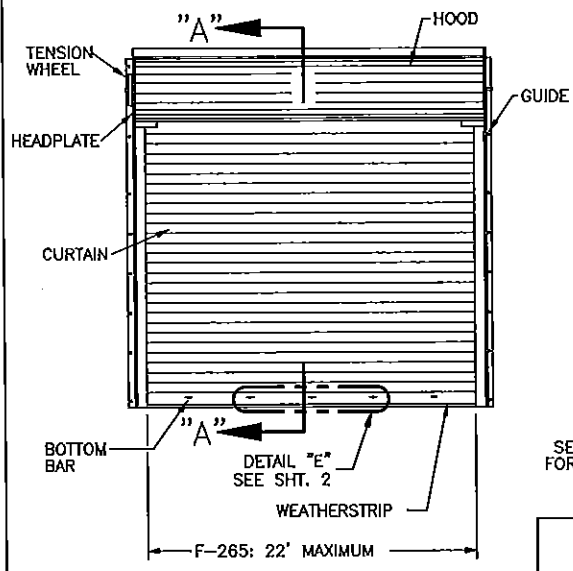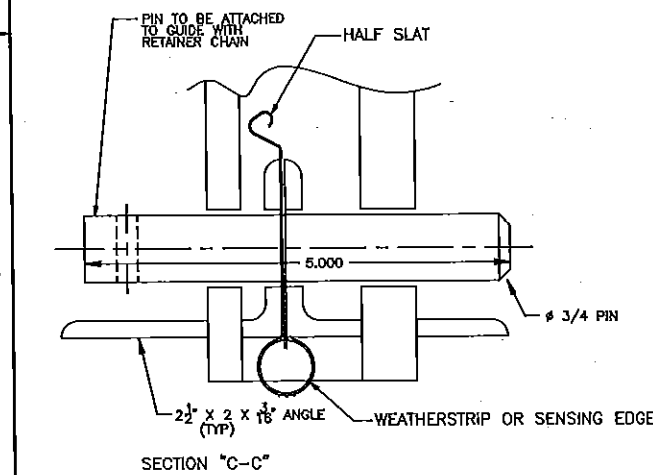

	ASSEMBLY BOLT	WALL BOLT STEEL JAMB	WALL ATTACHMENT CONCRETE JAMB
FIP	5/8\" GRADE 5, 10\" O.C.	5/8\" GRADE 5, 12\" O.C.	5/8\" X 5 1/2\" EMB HILTI KWIK BOLT 3 OR POWERS WEDGE BOLT 9\" O.C.

*3000 PSI MINIMUM & 8-1/2\" MINIMUM EDGE DISTANCE FOR ANCHORS.
NOTE: FOR DETAILS ON WELDING GUIDES TO STEEL JAMBS SEE SHEET 2.

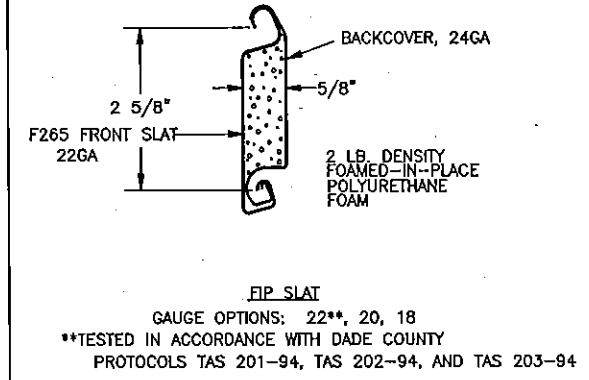

SERIES 626 IS EQUIVALENT CONSTRUCTION

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.			
TOLERANCES UNLESS OTHERWISE SPECIFIED		FINISH	
HOLE DIAMETER		5	
UNDER .251 +.004/-0.003		UNIT OF MEASURE	
.251 TO .500 +.006/-0.003		N/A	
OVER .500 +.008/-0.003			
FRACTIONS			
$\pm 1/16$			
ANGLES			
$\pm .5^\circ$			
REF DWG	USED ON		

NAME	DATE	DRAWING TITLE
G FINERAN	8/8/03	SERIES 626, ROLLING SERVICE DOOR 22 FT. DADE COUNTY
JD FAW	9/5/03	
L KRUPKE	9/5/03	


SCALE: NONE	SHEET 1 OF 2
-------------	--------------

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 15-1228-04
Expiration Date 10/14/2019
By [Signature]
Miami Field Product Control


MARK A. SAWICKI
LICENSE
No. 72613
2/12/15
STATE OF FLORIDA
PROFESSIONAL ENGINEER
OVERHEAD DOOR CORPORATION
2501 SOUTH STATE HWY 121 BUSINESS
LEWISVILLE, TX 75067
MARK A. SAWICKI, P.E. #72613

NOTES

1. REFER TO DRAWING 308670.0001 FOR TAG DETAILS
2. FASTENER FOR TAG IS P/N 080276-1004(STEEL DRIVE SCREW). TAG WILL BE MOUNTED IN THE MIDDLE OF THE BOTTOM BAR.


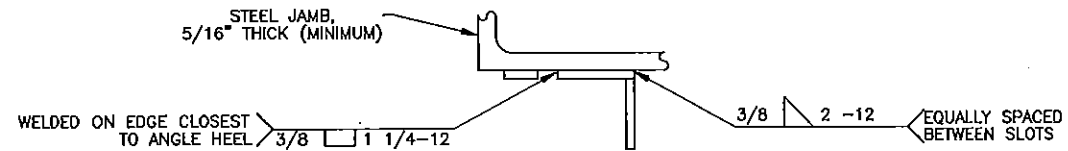


TOP VIEW

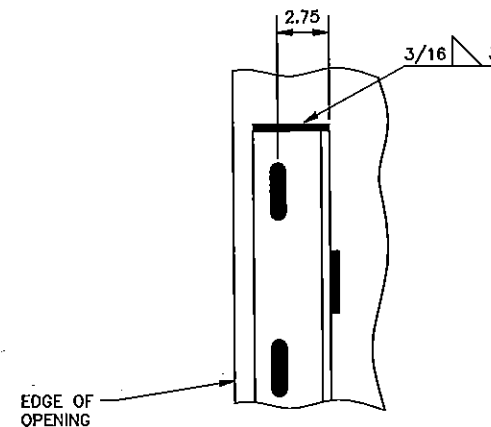


FRONT VIEW OF WALL ANGLE

DETAILS FOR WELDING "E" GUIDES TO STEEL JAMBS

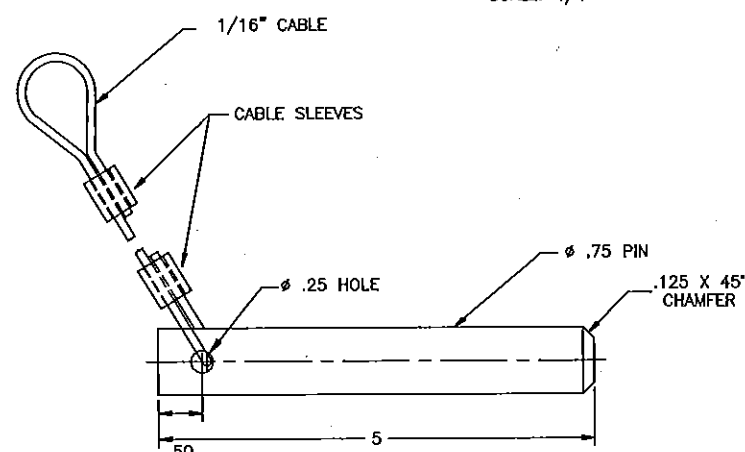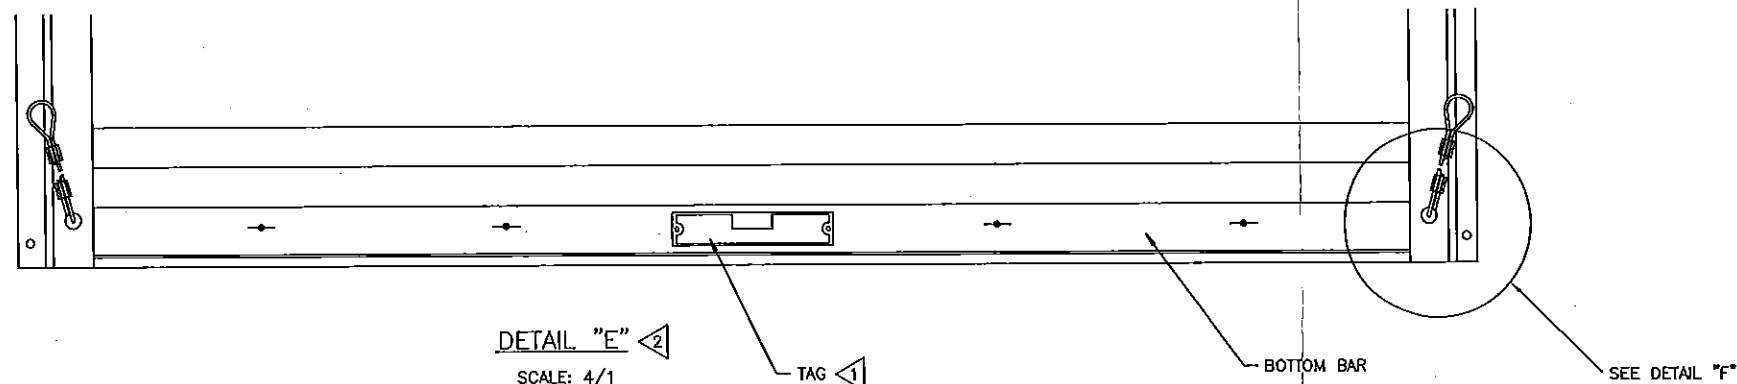



DETAIL "F"

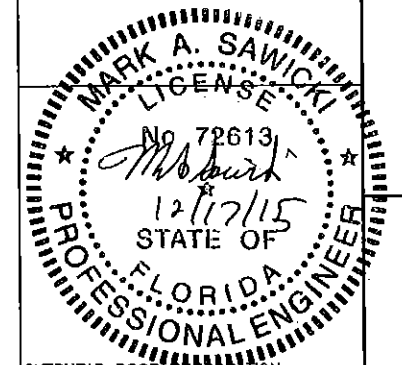PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 15-1228.04
Expiration Date 10/14/2019
By *[Signature]*
Missouri Door Product Control



OVERHEAD DOOR CORPORATION
2501 SOUTH STATE HWY 121 BUSINESS
LEWISVILLE, TX 75067

MARK A. SAWICKI, P.E. #72613

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.																			
		TOLERANCES UNLESS OTHERWISE SPECIFIED		FINISH		The Genuine, The Original.		NAME		DATE		DRAWING TITLE							
		HOLE DIAMETER		N/A				LEWISVILLE, TEXAS		M. WOMACK		10/10/03		SERIES 625, ROLLING SERVICE DOOR 22 FT. DADE COUNTY					
ASME Y14.100 AND Y14.5 APPLY UNLESS OTHERWISE SPECIFIED. DIMENSIONS ARE IN U.S. CUSTOMARY UNITS.		UNDER .251 +.004/-0.003		WHOLE NUMBERS: ± .25		UNIT OF MEASURE		MATERIAL		DESIGNED BY		10/10/03		DRAWING NUMBER D- 308134					
		.251 TO .500 +.006/-0.003		X ± .1															
		OVER .500 +.008/-0.003		X ± .03															
		FRACTIONS		X ± .010															
RFF DWG		USFD ON		± 1/16		ANGLES: ± .5°		N/A		N/A		APPROVED BY L KRUPKE		10/10/03		SCALES NOTED		SHEET 2 OF 2	

DRAWING TITLE: SERIES 625, ROLLING SERVICE DOOR 22 FT. DADE COUNTY

DRAWING NUMBER: D- 308134

SCALE: NOTED SHEET 2 OF 2